
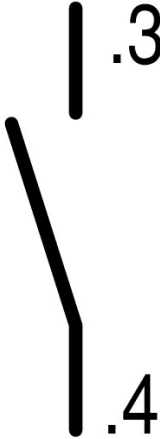






**Contact element, Screw terminals, Base fixing, 1 N/O, 24 V 3 A, 220 V 230 V 240 V 6 A**

**Part no.** M22-KC10  
**Catalog No.** 216380  
**Alternate Catalog No.** M22-KC10Q  
**EL-Nummer (Norway)** 4355365

**Delivery program**

|  |  |  |
|--|--|--|
| Basic function accessories   |  | Contact elements   |
| Connection technique   |  | Screw terminals  |
| Fixing   |  | Base fixing  |
| Degree of Protection   |  | IP20   |
| Connection to SmartWire-DT   |  | no   |
| Approval   |  |   |
| <b>Contacts</b>  |  |  |
| N/O = Normally open  |  | 1 N/O  |
| Contact sequence   |  |  |
| <b>Contact travel diagram, stroke in connection with front element</b> |  |  |
| Contact diagram  |  |  |
| Configuration  |  |  |
| Connection type  |  | Single contact   |
| Connection technique   |  | Screw terminals  |
| <b>Notes</b>   |  |  |
| Up to 3 off per enclosure base   |  |  |

## Technical data

### General

|   |              |                 |  |
|---|--------------|-----------------|--|
| Standards   |              |                 | IEC 60947-5-1  |
| Lifespan, mechanical  | Operations   | $\times 10^6$   | > 5  |
| Operating frequency   | Operations/h |                 | $\leq 3600$  |
| Actuating force   |              | n               | $\leq 5$   |
| Operating torque (screw terminals)  |              | Nm              | $\leq 0.8$   |
| Degree of Protection  |              |                 | IP20   |
| Climatic proofing   |              |                 | Damp heat, constant, to IEC 60068-2-78<br>Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature   |              |                 |  |
| Open  |              | °C              | -25 - +70  |
| Mechanical shock resistance to IEC 60068-2-27 Shock duration 11 ms, half-sinusoidal |              | g               | > 30   |
| Terminal capacities   |              | mm <sup>2</sup> |  |
| Solid   |              | mm <sup>2</sup> | 0.75 - 2.5   |
| Stranded  |              | mm <sup>2</sup> | 0.5 - 2.5  |
| Flexible with ferrule   |              | mm <sup>2</sup> | 0.5 - 1.5  |

### Contacts

|                                       |           |                   |   |
|---------------------------------------|-----------|-------------------|---|
| Rated impulse withstand voltage       | $U_{imp}$ | V AC              | 6000  |
| Rated insulation voltage              | $U_i$     | V                 | 500   |
| Overvoltage category/pollution degree |           |                   | III/3   |
| Control circuit reliability           |           |                   |   |
| at 24 V DC/5 mA                       | $H_F$     | Fault probability | $< 10^{-7}$ (i.e. 1 failure to $10^7$ operations)                   |
| at 5 V DC/1 mA                        | $H_F$     | Fault probability | $< 5 \times 10^{-6}$ (i.e. 1 failure in $5 \times 10^6$ operations) |
| Max. short-circuit protective device  |           |                   |   |
| Fuseless                              |           | Type              | PKZM0-10/FAZ-B6/1   |
| Fuse                                  | gG/gL     | A                 | 10  |

### Switching capacity

|                           |            |               |     |
|---------------------------|------------|---------------|-----|
| Rated operational current | $I_e$      | A             |     |
| AC-15                     |            |               |     |
| 115 V                     | $I_e$      | A             | 6   |
| 220 V 230 V 240 V         | $I_e$      | A             | 6   |
| 380 V 400 V 415 V         | $I_e$      | A             | 4   |
| 500 V                     | $I_e$      | A             | 2   |
| DC-13                     |            |               |     |
| 24 V                      | $I_e$      | A             | 3   |
| 42 V                      | $I_e$      | A             | 1.7 |
| 60 V                      | $I_e$      | A             | 1.2 |
| 110 V                     | $I_e$      | A             | 0.6 |
| 220 V                     | $I_e$      | A             | 0.3 |
| Lifespan, electrical      |            |               |     |
| AC-15                     |            |               |     |
| 230 V/0.5 A               | Operations | $\times 10^6$ | 1.6 |
| 230 V/1.0 A               | Operations | $\times 10^6$ | 1   |
| 230 V/3.0 A               | Operations | $\times 10^6$ | 0.7 |
| DV-13                     |            |               |     |
| 12 V/2.8 A                | Operations | $\times 10^6$ | 1.2 |

## Design verification as per IEC/EN 61439

|  |           |   |      |
|--|-----------|---|------|
| Technical data for design verification                   |           |   |      |
| Rated operational current for specified heat dissipation | $I_n$     | A | 6    |
| Heat dissipation per pole, current-dependent             | $P_{vid}$ | W | 0.11 |

|  |                   |    |  |
|--|-------------------|----|--|
| Equipment heat dissipation, current-dependent  | P <sub>vid</sub>  | W  | 0  |
| Static heat dissipation, non-current-dependent   | P <sub>vs</sub>   | W  | 0  |
| Heat dissipation capacity  | P <sub>diss</sub> | W  | 0  |
| Operating ambient temperature min.   |                   | °C | -25  |
| Operating ambient temperature max.   |                   | °C | 70   |
| IEC/EN 61439 design verification   |                   |    |  |
| 10.2 Strength of materials and parts   |                   |    |  |
| 10.2.2 Corrosion resistance  |                   |    | Meets the product standard's requirements.   |
| 10.2.3.1 Verification of thermal stability of enclosures   |                   |    | Meets the product standard's requirements.   |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat   |                   |    | Meets the product standard's requirements.   |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |                   |    | Meets the product standard's requirements.   |
| 10.2.4 Resistance to ultra-violet (UV) radiation   |                   |    | Meets the product standard's requirements.   |
| 10.2.5 Lifting   |                   |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.6 Mechanical impact   |                   |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.7 Inscriptions  |                   |    | Meets the product standard's requirements.   |
| 10.3 Degree of protection of ASSEMBLIES  |                   |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.4 Clearances and creepage distances   |                   |    | Meets the product standard's requirements.   |
| 10.5 Protection against electric shock   |                   |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.6 Incorporation of switching devices and components   |                   |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.7 Internal electrical circuits and connections  |                   |    | Is the panel builder's responsibility.   |
| 10.8 Connections for external conductors   |                   |    | Is the panel builder's responsibility.   |
| 10.9 Insulation properties   |                   |    |  |
| 10.9.2 Power-frequency electric strength   |                   |    | Is the panel builder's responsibility.   |
| 10.9.3 Impulse withstand voltage   |                   |    | Is the panel builder's responsibility.   |
| 10.9.4 Testing of enclosures made of insulating material   |                   |    | Is the panel builder's responsibility.   |
| 10.10 Temperature rise   |                   |    | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating   |                   |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.12 Electromagnetic compatibility  |                   |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.13 Mechanical function  |                   |    | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.                         |


## Technical data ETIM 7.0

|  |  |   |                  |
|--|--|---|------------------|
| Low-voltage industrial components (EG000017) / Auxiliary contact block (EC000041)  |  |   |                  |
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Component for low-voltage switching technology / Auxiliary switch block (ecl@ss10.0.1-27-37-13-02 [AKN342013]) |  |   |                  |
| Number of contacts as change-over contact  |  |   | 0                |
| Number of contacts as normally open contact  |  |   | 1                |
| Number of contacts as normally closed contact  |  |   | 0                |
| Number of fault-signal switches  |  |   | 0                |
| Rated operation current I <sub>e</sub> at AC-15, 230 V   |  | A | 6                |
| Type of electric connection  |  |   | Screw connection |
| Model  |  |   | Top mounting     |
| Mounting method  |  |   | Floor fastening  |
| Lamp holder  |  |   | None             |

## Approvals

|                             |  |  |  |
|-----------------------------|--|--|--|
| Product Standards           |  |  | IEC/EN 60947-5; UL 508; CSA-C22.2 No. 14-05; CSA-C22.2 No. 94-91; CE marking |
| UL File No.                 |  |  | E29184   |
| UL Category Control No.     |  |  | NKCR   |
| CSA File No.                |  |  | 012528   |
| CSA Class No.               |  |  | 3211-03  |
| North America Certification |  |  | UL listed, CSA certified   |
| Degree of Protection        |  |  | UL/CSA Type: -   |

## Dimensions

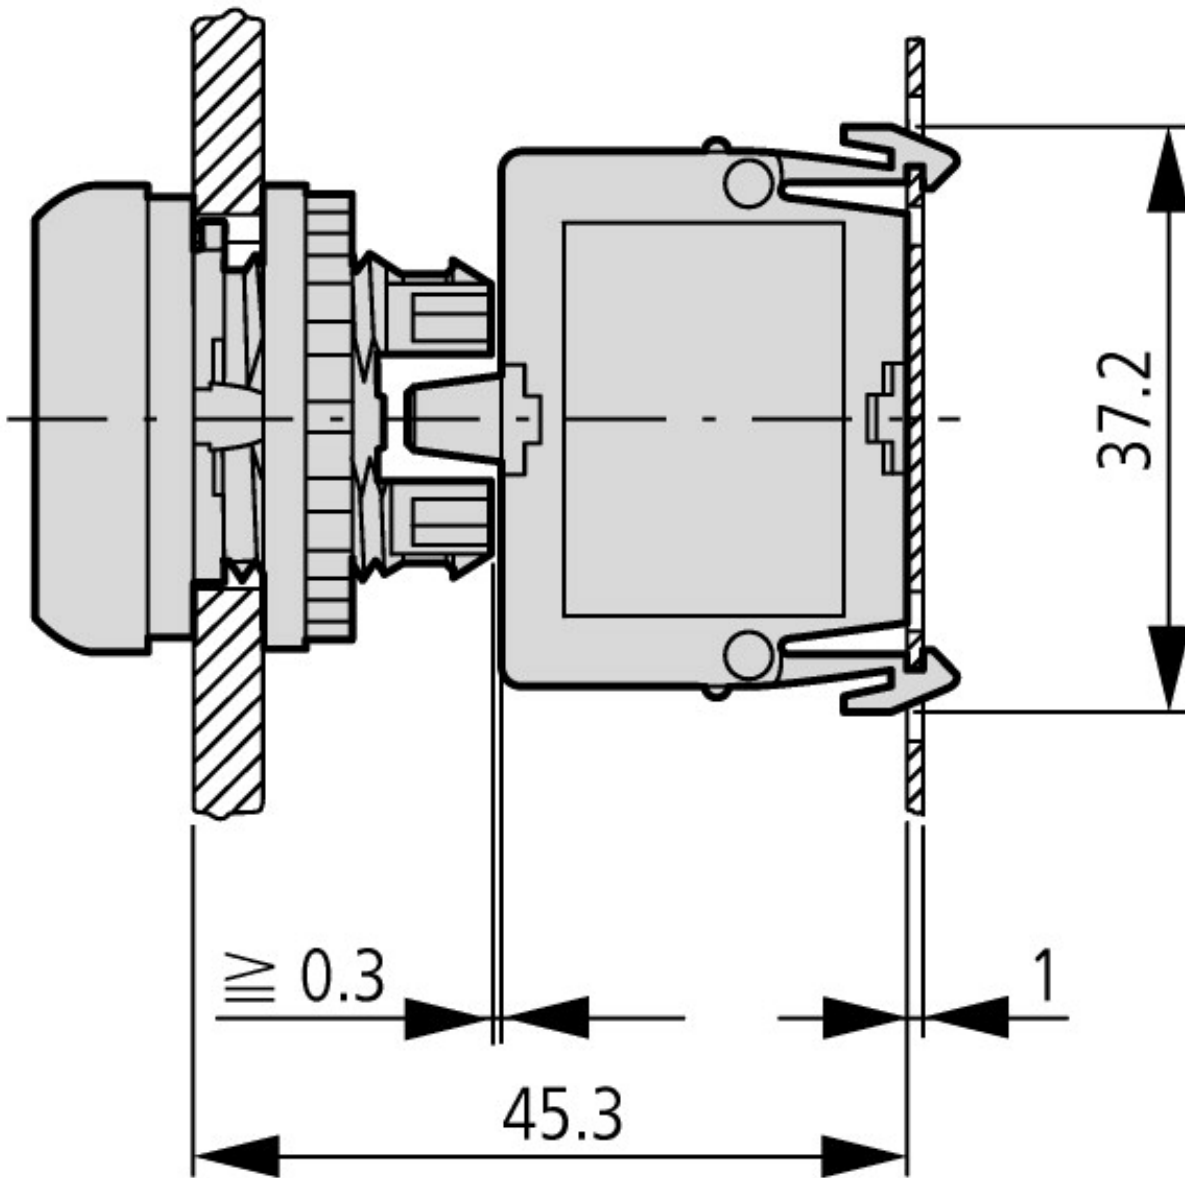

Pushbutton with M22-(C)K...  
Pushbutton with M22-(C) LED... + M22-XLED...

## Additional product information (links)

DGUV Test Mark Customer Information

[http://www.dguv.de/medien/dguv-test-medien/\\_pdf\\_zip\\_doc\\_ppt/agb-und-pzo/dguv\\_test\\_zeichen\\_infoblatt\\_kunden.pdf](http://www.dguv.de/medien/dguv-test-medien/_pdf_zip_doc_ppt/agb-und-pzo/dguv_test_zeichen_infoblatt_kunden.pdf)